


North East Mississippi Electric Power Association
(662) 238-3160 or toll free (877) 234-6331 ext. 3160

Meter Base and Weather Head Installation Below Roof Diagram

Must have a minimum of 10' from ground to the Weather Head

- 200 Amp services require a minimum of 2 – 2/0 **COPPER** black hot legs and 1 – #2 **COPPER** white neutral leg installed in 2" electrical PVC or rigid metal conduit.
- 100 Amp services require a minimum of 2 – #2 **COPPER** black hot legs and 1 – #2 **COPPER** white neutral leg installed in 1 1/4" electrical PVC or rigid metal conduit.
- Meter Base should be mounted at eye level.
- Top of weather head must be a **MINIMUM** of 10' above the ground level!
- #6 bare copper installed from 8' ground rod to meter base.

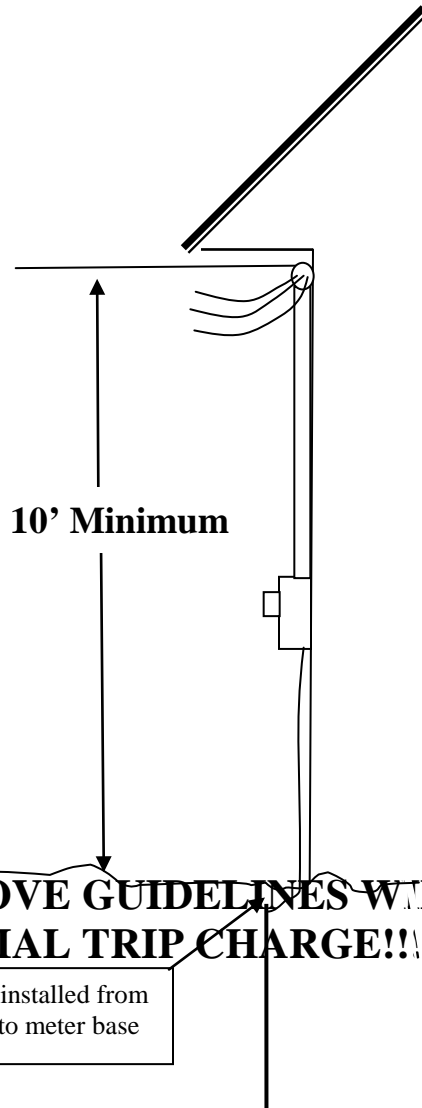

INSTALLATIONS NOT MEETING THE ABOVE GUIDELINES WILL BE REJECTED AND SUBJECT TO A SPECIAL TRIP CHARGE!!!!