


North East Mississippi Electric Power Association
(662) 234-6331 or toll free (877) 234-6331

Conduit Installation for Underground Services Permanent Structures Only

Call Mississippi One Call Before You DIG!!!

1-800-227-6477

- 200 Amp services require a minimum of 2 ½" schedule 40 Electrical PVC. (Grey Pipe). Above 200 amp - 3" minimum (Check with the Engineering Department)
- Conduit must be installed to a **MINIMUM** depth of 24"!
- Install conduit to a point a minimum of 3 feet from the source of power.
- Cover the both ends of conduit with a cap or tape to prevent water and/or dirt from entering the pipe. (This includes the meter base).
- Install Warning Ribbon approximately 12" above conduit.
- Clearly mark the end of the conduit so it can be found by North East Power.

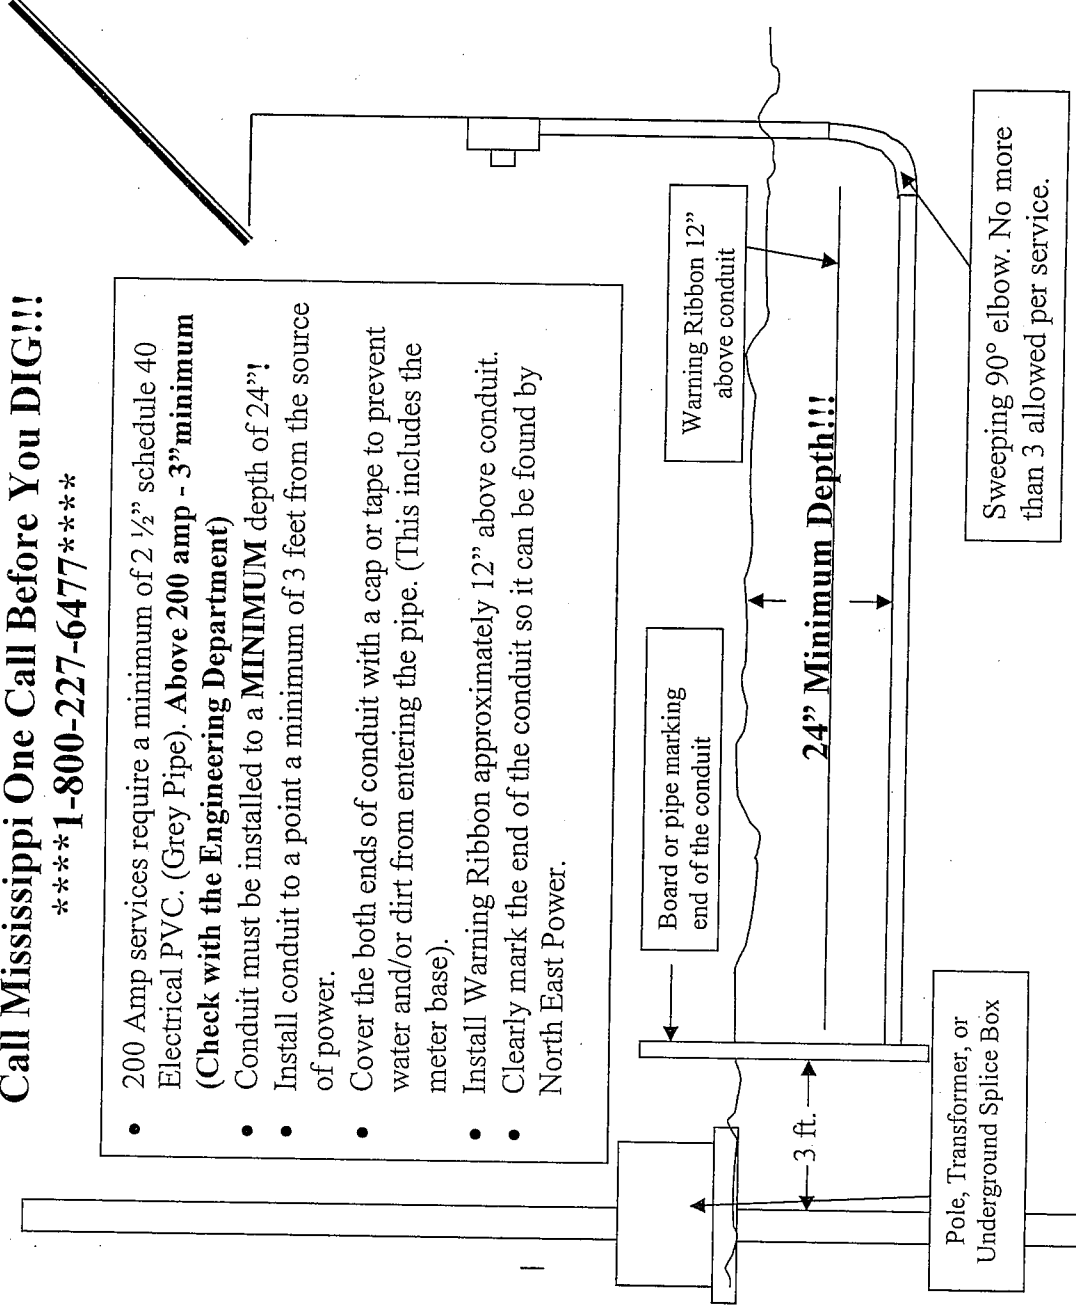

- Once the meter base location has been established, notify the Engineering Department.
- A Staking Engineer will inspect the location, design the service entrance, provide the customer a sketch of the conduit path, and drive a stake where the conduit should end.
- The customer must install the conduit duct meeting North East MS EPA specifications. The customer will be charged for any correction or repairs made to the conduit duct during the installation of service.
- Once the conduit duct is complete with the meter base and switchbox installed, notify the Engineering Department.
- Service Crews will be scheduled to install the wire and make the final connection as soon as possible.
- **INSTALLATIONS NOT MEETING THE ABOVE GUIDELINES WILL BE REJECTED AND SUBJECT TO A SPECIAL TRIP CHARGE!!!!**