




## Underground Temporary Service

To be used in only where underground primary is available

\*\*\*\* CALL MISSISSIPPI ONE CALL BEFORE YOU DIG \*\*\*\*  
**(800) 227-6477**

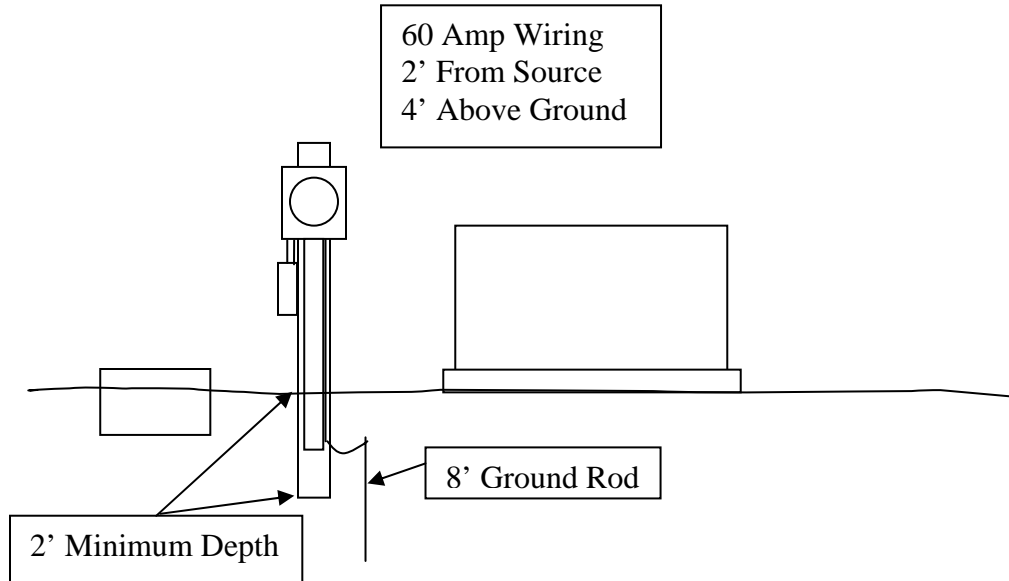

**CALL MISSISSIPPI ONE CALL BEFORE YOU DIG (800) 227-6477.** Mount meter base with a minimum 60Amp service and weatherproof disconnect box on a minimum 4" x 4" post that is at least 2 feet in the ground and a minimum of 4' above the ground. Use 2" conduit from meter base to 18" deep. Install temporary 2' from the source of power such as underground splice box or a pad mount transformer. Temporary services installed near splice boxes must have their own 8' ground rod install and connected to the meter base. Do not install ground rods near a transformer. **All receptacles must have GFI protection.**

Any temporary service deemed unsafe by any Northeast MS EPA employee will be disconnected without notice and will be re-connected when it is made safe.

**PLEASE CALL NORTH EAST MISSISSIPPI ELECTRIC POWER  
ASSOCIATION IF YOU HAVE ANY QUESTIONS!!! (662) 234-6331**